

Auditing Test Report

Report No. 258816/5

Date: 21/07/2024

Client

Saudi Vitrified Clay Pipe Co.
P.O. Box 6415
Riyadh 11442
Kingdom of Saudi Arabia

Sampling Date: 17/07/2024

Test Date: 18/07/2024

Auditing Purpose:

Testing of Perforated Vitrified Clay Pipes jointed by system F according to EN 295-5:2013

Size Description:


Nominal Size: DN 100 * 1000 mm Half Perforated
Jointing System: System F
Class: 34 KN/m

Description of Sampling

Samples were collected randomly from the stock at the client's manufacturing works in Riyadh (Kingdom of Saudi Arabia) by the agent of the Suhaimi - Fugro

Underlying specification /description of the tests

EN 295-1:2013	"Vitrified clay pipe systems for drains and sewers - Part 1: Requirements for pipes, fittings & joints"
EN 295-5:2013	"Vitrified clay pipe systems for drains and sewers - Part 5: Requirements for perforated pipes & fittings"
EN 295-2:2013	"Vitrified clay pipe systems for drains and sewers - Part 2: Evaluation of conformity and sampling"
EN 295-3:2012	"Vitrified clay pipe systems for drains and sewers - Part 3: Test Methods"

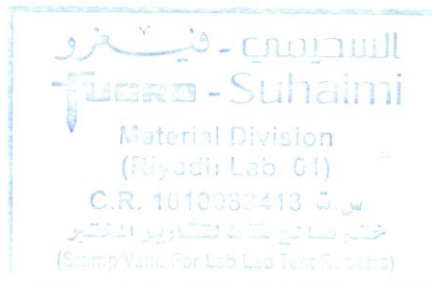

(Handwritten signature)

Test Results of DN 100 HP

Report No. 258816/5

	Test Type	Unit	Sample 1	Sample 2	Sample 3	Req.	Result
Pipes	Marking (visual Inspection)	-	✓	✓	✓	✓	✓
	Crushing Strength	KN/m	35	36	37	≥ 34	✓
	Internal Barrel Diameter "D1"	mm	101	102	99	≥ 96	✓
	Length	mm	1005	1002	1001	1000 ^{+5%} _{-2%}	✓
	Deviation from Straightness	mm	5.3	5.2	5.1	< 6.0	✓
	Perforation Area	mm ² /m	6280			≥ 300	✓
	Water Absorption	%	1.8	1.1	1.2	≤ 6 %	✓
Joint Assembly	Joint Interchangeability	mm	132.2	131.2	131.8	131 ± 1.5	✓
	Continuity of Invert	mm	3.2	3.3	3.2	≤ 4	✓

FUGRO - SUHAIMI LTD

Mohammad Afaq

